

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: ALUMINUM 6063-T5
12. UNITS MUST BE GLAZED PER ASTM E1300-04/09, SEE SHEET 2 FOR GLASS DETAIL.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #6 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #12 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #12 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42

B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.

C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.

D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .048" THICK MINIMUM

SIGNED: 08/27/2018

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATIONS AND GLAZING DETAIL
3 - 6	INSTALLATION DETAILS
7	COMPONENTS

ALL SEASONS COMMERCIAL
1293 NORTH HARVEY MITCHELL PARKWAY
BRYAN, TX 77803

SERIES 3250 ALUMINUM SINGLE HUNG WINDOW
60" X 84" LARGE AND SMALL MISSILE IMPACT
NOTES

DRAWN:
A.R.

DWG NO.
08-03274

REV
--


SCALE
NTS

DATE
07/13/18


SHEET
1

OF
7


L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com




REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

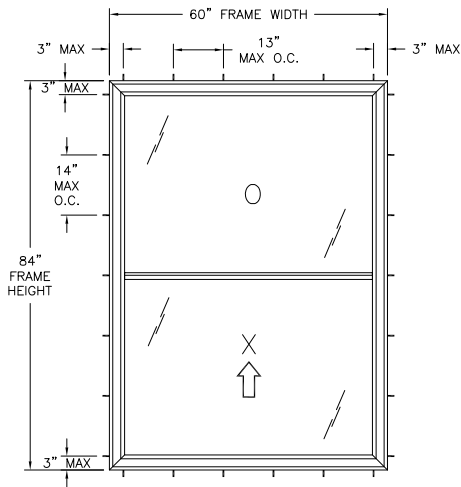

SERIES 3250 SINGLE HUNG WINDOW
EXTERIOR VIEW
FRAME INSTALLATION

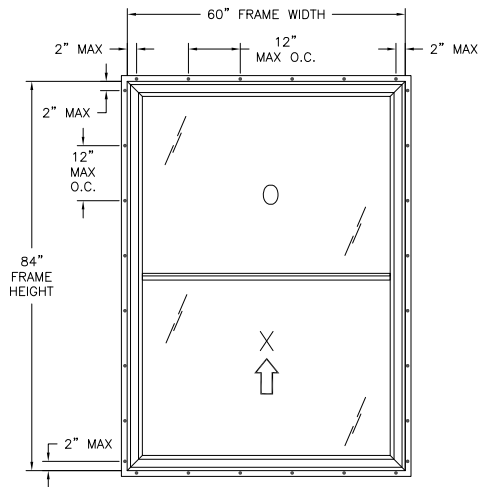

SERIES 3250 SINGLE HUNG WINDOW
EXTERIOR VIEW
FIN INSTALLATION

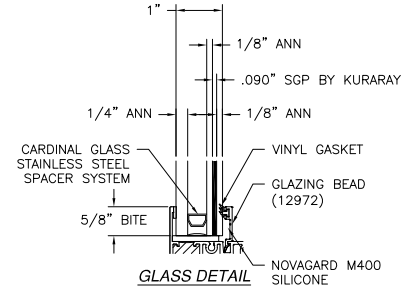

DESIGN PRESSURE RATING	IMPACT RATING
± 75.0 PSF	LARGE AND SMALL MISSILE IMPACT

60" X 84" UNIT SHOWN. OTHER SIZES APPROVED AS LONG AS
FRAME AREA DOES NOT EXCEED 35.0 FT²

- NOTES:
- SASH SIZE: 58" x 41 3/8"
 - FIXED D.L.O.: 55" X 37"
 - SASH D.L.O.: 54 1/4" x 37"

HARDWARE SCHEDULE

A.	(1) METALLIC SWEEP LOCK SPACED 1 1/2" FROM EACH END OF SASH TOP RAIL
B.	(2) ONE SPIRAL BALANCE PER SASH STILE




SIGNED: 08/27/2018

ALL SEASONS COMMERCIAL 1293 NORTH HARVEY MITCHELL PARKWAY BRYAN, TX 77803			
SERIES 3250 ALUMINUM SINGLE HUNG WINDOW 60" X 84" LARGE AND SMALL MISSILE IMPACT ELEVATIONS AND GLAZING DETAIL			
DRAWN: A.R.	DWG NO. 08-03274	REV. —	
SCALE NTS	DATE 07/13/18	SHEET 2 OF 7	

L. ROBERTO LOMAS P.E.
 1432 WOODFORD RD LEWISVILLE, NC 27023
 434-688-0609 rllomas@rllomaspe.com

Luis R. Lomas P.E.
 FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

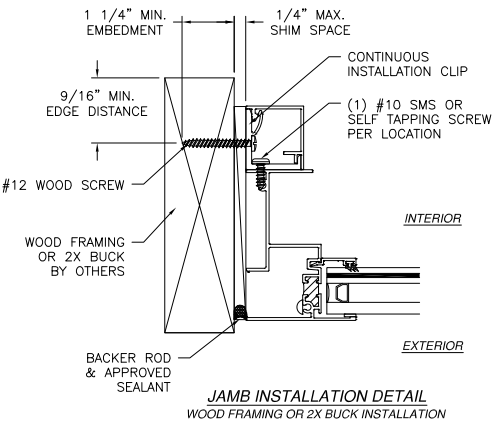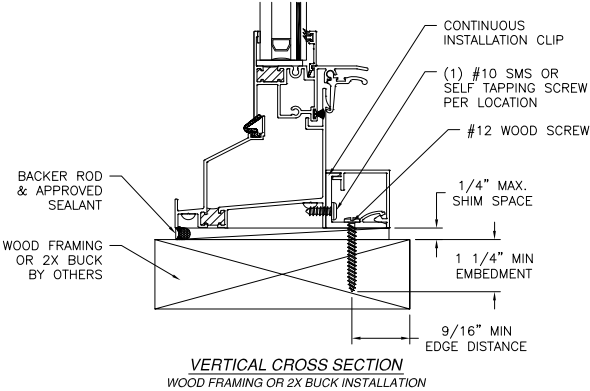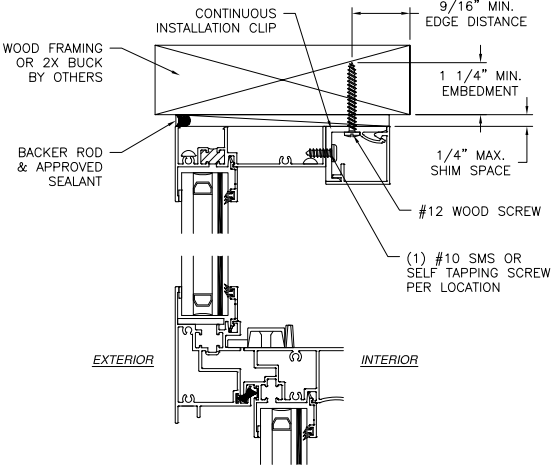

- NOTES:
- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/27/2018

ALL SEASONS COMMERCIAL
1293 NORTH HARVEY MITCHELL PARKWAY
BRYAN, TX 77803

SERIES 3250 ALUMINUM SINGLE HUNG WINDOW
60" X 84" LARGE AND SMALL MISSILE IMPACT
INSTALLATION DETAILS

DRAWN:
A.R.

DWG NO.
08-03274

REV
—

SCALE
NTS

DATE
07/13/18




SHEET
3 OF 7

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com



Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

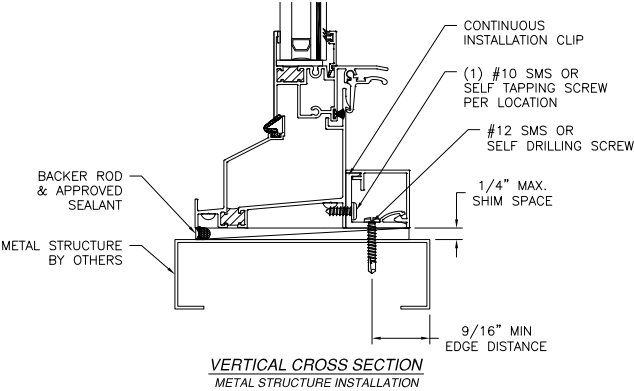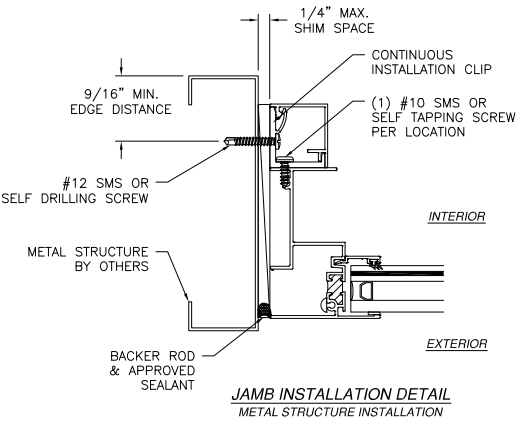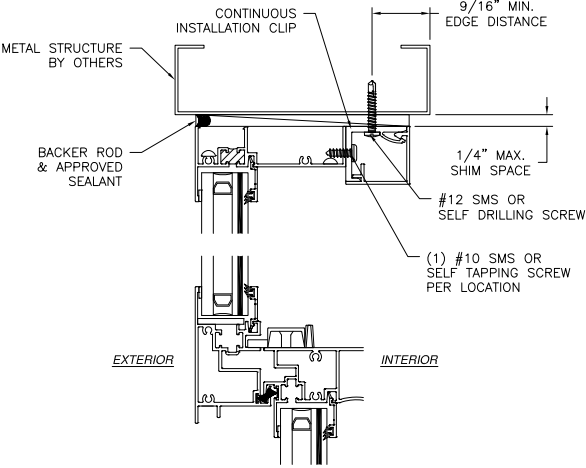




- NOTES:
- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/27/2018

ALL SEASONS COMMERCIAL			
1293 NORTH HARVEY MITCHELL PARKWAY			
BRYAN, TX 77803			
SERIES 3250 ALUMINUM SINGLE HUNG WINDOW			
60" X 84" LARGE AND SMALL MISSILE IMPACT			
INSTALLATION DETAILS			
DRAWN:		DWG NO.	
A.R.		08-03274	
SCALE		DATE	
NTS		07/13/18	
		SHEET 4 OF 7	
L. ROBERTO LOMAS P.E.			
1432 WOODFORD RD LEWISVILLE, NC 27023			
434-688-0609 rllomas@rllomaspe.com			



Luis R. Lomas P.E.
FL No.: 62514

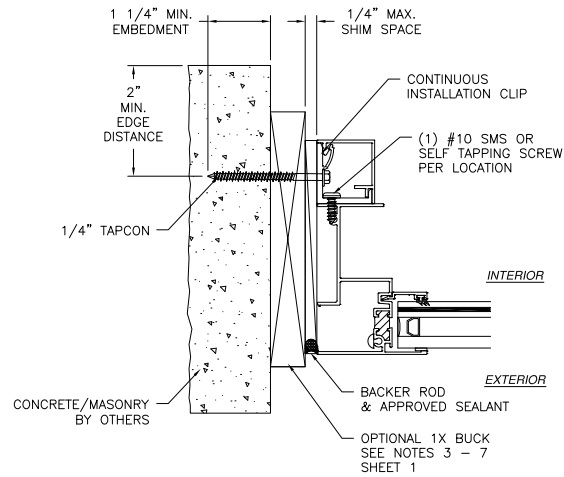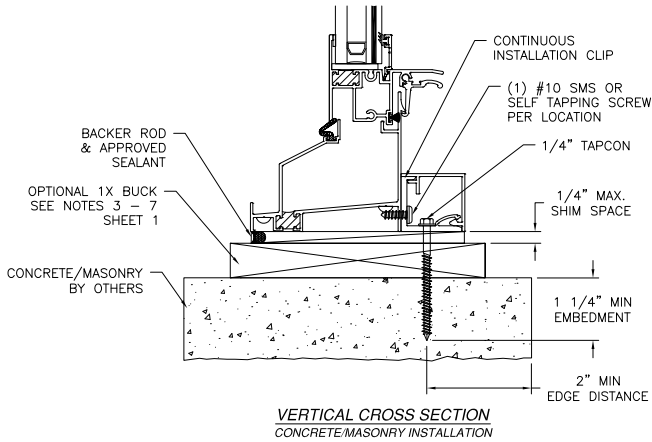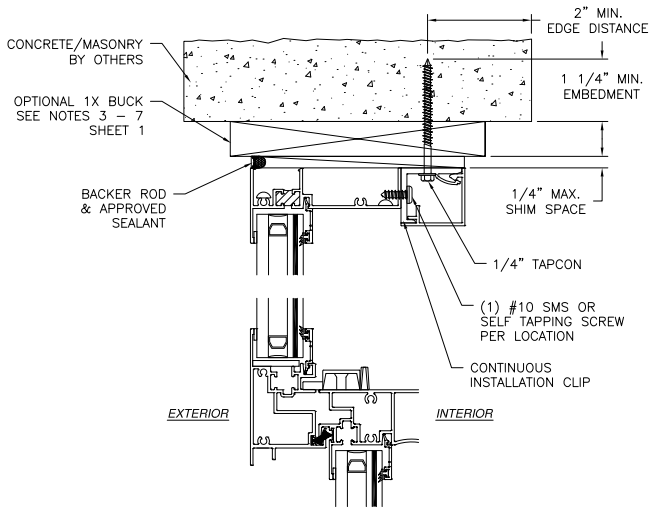


JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION



- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/27/2018

ALL SEASONS COMMERCIAL			
1293 NORTH HARVEY MITCHELL PARKWAY BRYAN, TX 77803			
SERIES 3250 ALUMINUM SINGLE HUNG WINDOW 60" X 84" LARGE AND SMALL MISSILE IMPACT INSTALLATION DETAILS			
DRAWN: A.R.	DWG NO. 08-03274	REV. —	
SCALE NTS	DATE 07/13/18	SHEET 5	OF 7
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@rlromaspe.com			




REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

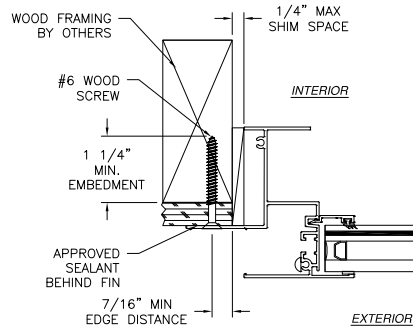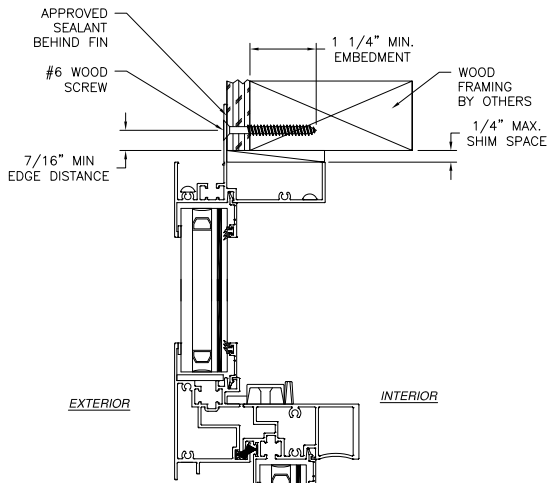

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 08/27/2018

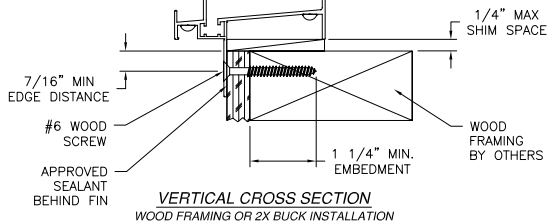


VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

ALL SEASONS COMMERCIAL 1293 NORTH HARVEY MITCHELL PARKWAY BRYAN, TX 77803			
SERIES 3250 ALUMINUM SINGLE HUNG WINDOW 60" X 84" LARGE AND SMALL MISSILE IMPACT INSTALLATION DETAILS			
DRAWN: A.R.	DWG NO. 08-03274	REV. —	
SCALE NTS	DATE 07/13/18	SHEET 6 OF 7	
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@rllomaspe.com			
			Luis R. Lomas P.E. FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED




**HEAD
FIN INSTALLATION**
ALUMINUM 6063-T5 (12964)




**HEAD
FRAME INSTALLATION**
ALUMINUM 6063-T5 (12964)




**SILL
FIN INSTALLATION**
ALUMINUM 6063-T5 (12966)




**SILL
FRAME INSTALLATION**
ALUMINUM 6063-T5 (12966)




MEETING RAIL
ALUMINUM 6063-T5 (12957)




**JAMB
FRAME INSTALLATION**
ALUMINUM 6063-T5 (12965)




**JAMB
FIN INSTALLATION**
ALUMINUM 6063-T5 (12965)




SASH JAMB
ALUMINUM 6063-T5 (12969)




SASH SILL
ALUMINUM 6063-T5 (12970)




SASH HEAD
ALUMINUM 6063-T5 (12953)



GLAZING BEAD
ALUMINUM 6063-T5 (12972)



INSTALL CLIP
ALUMINUM 6063-T5 (970)



INSTALL CLIP COVER
ALUMINUM 6063-T5 (969)

SIGNED: 08/27/2018

ALL SEASONS COMMERCIAL 1293 NORTH HARVEY MITCHELL PARKWAY BRYAN, TX 77803			
SERIES 3250 ALUMINUM SINGLE HUNG WINDOW 60" X 84" LARGE AND SMALL MISSILE IMPACT COMPONENTS			
DRAWN: A.R.	DWG NO. 08-03274	REV. —	
SCALE NTS	DATE 07/13/18	SHEET 7 OF 7	
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@rllomaspe.com			

Luis R. Lomas
Professional Engineer
No. 62514
State of Florida

Luis R. Lomas P.E.
FL No.: 62514